



**CVM A/4 (0.3 kW) MEI > 0.60 - Impeller diameter = 102 mm**  
**CVM A/6 (0.44 kW) MEI > 0.60 - Impeller diameter = 102 mm**  
**CVM A/8 (0.6 kW) MEI > 0.60 - Impeller diameter = 102 mm**

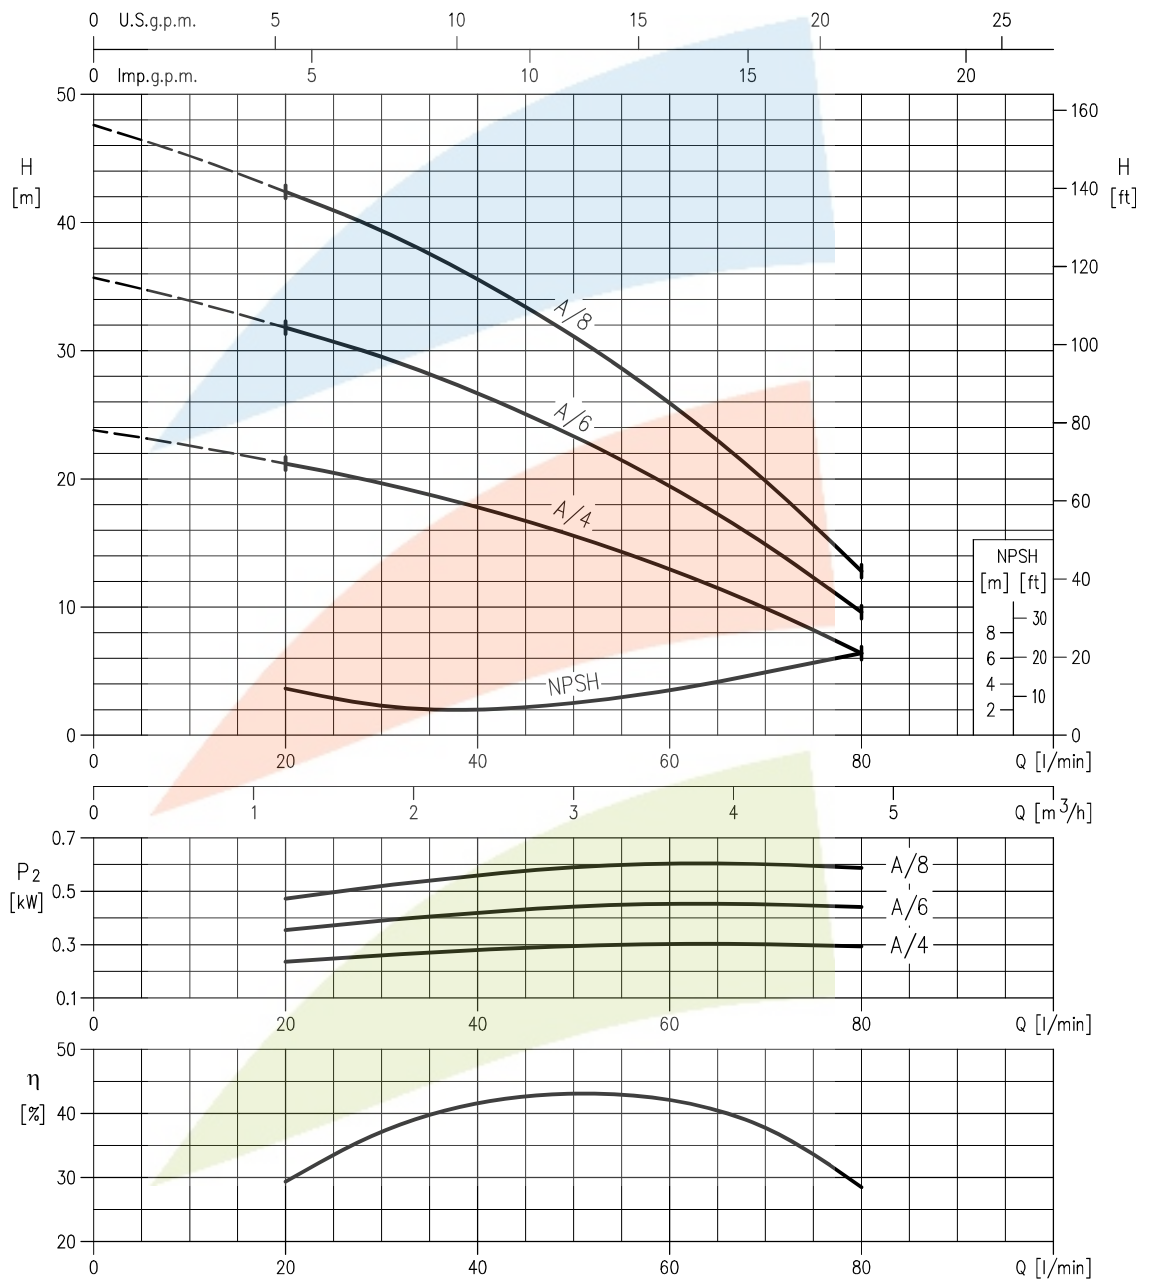


Rotation speed  $\approx 2800 \text{ min}^{-1}$   
 Test standard: ISO 9906 – Annex A

**CVM A/10 (0.75 kW) MEI > 0.60 - Impeller diameter = 102 mm**  
**CVM A/12 (0.9 kW) MEI > 0.60 - Impeller diameter = 102 mm**  
**CVM A/15 (1.1 kW) MEI > 0.60 - Impeller diameter = 102 mm**

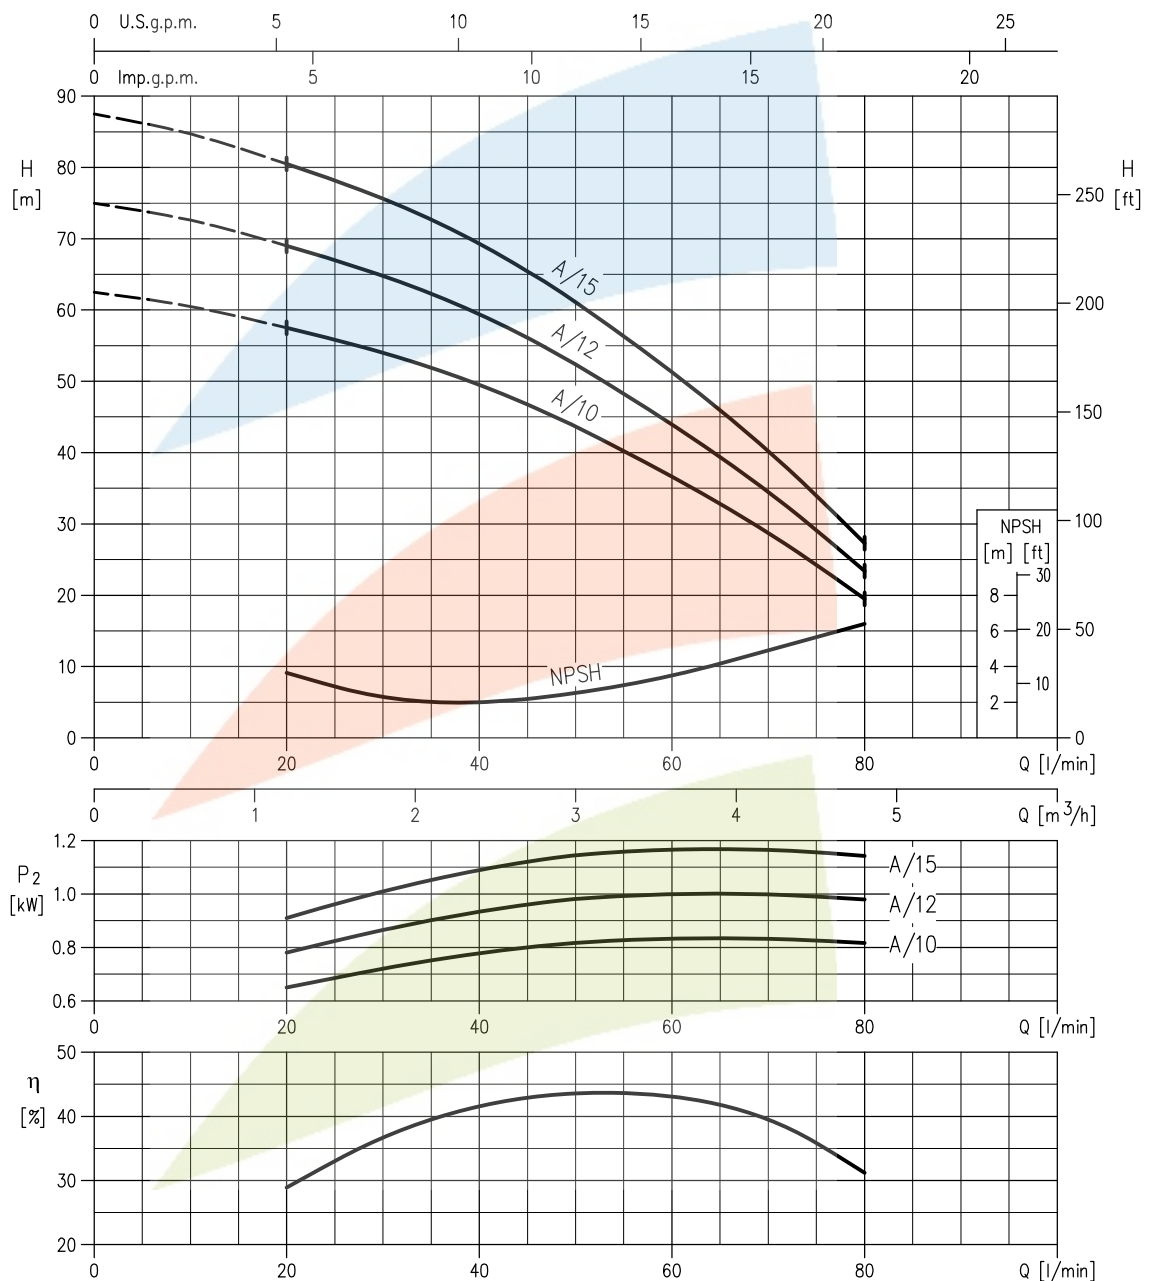


Rotation speed  $\approx 2800 \text{ min}^{-1}$   
 Test standard: ISO 9906 – Annex A

CVM A/18 (1.3 kW) MEI > 0.60 - Impeller diameter = 102 mm

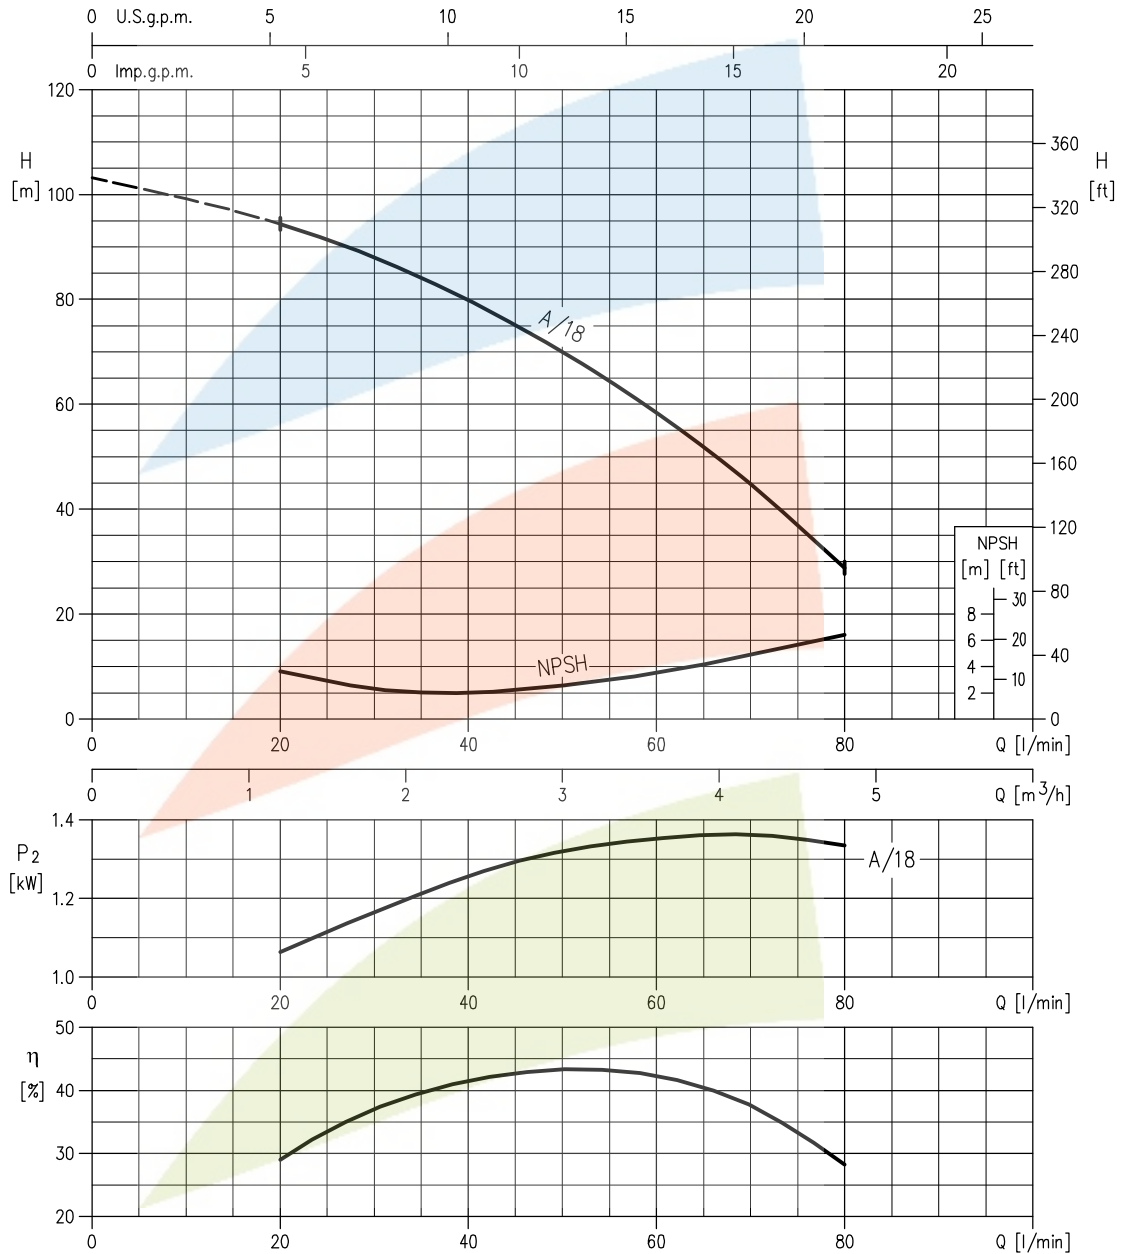


Rotation speed ≈ 2800 min<sup>-1</sup>  
 Test standard: ISO 9906 – Annex A

**CVM B/10 (0.75 kW) MEI > 0.70 - Impeller diameter = 102 mm**  
**CVM B/12 (0.9 kW) MEI > 0.70 - Impeller diameter = 102 mm**  
**CVM B/15 (1.1 kW) MEI > 0.70 - Impeller diameter = 102 mm**

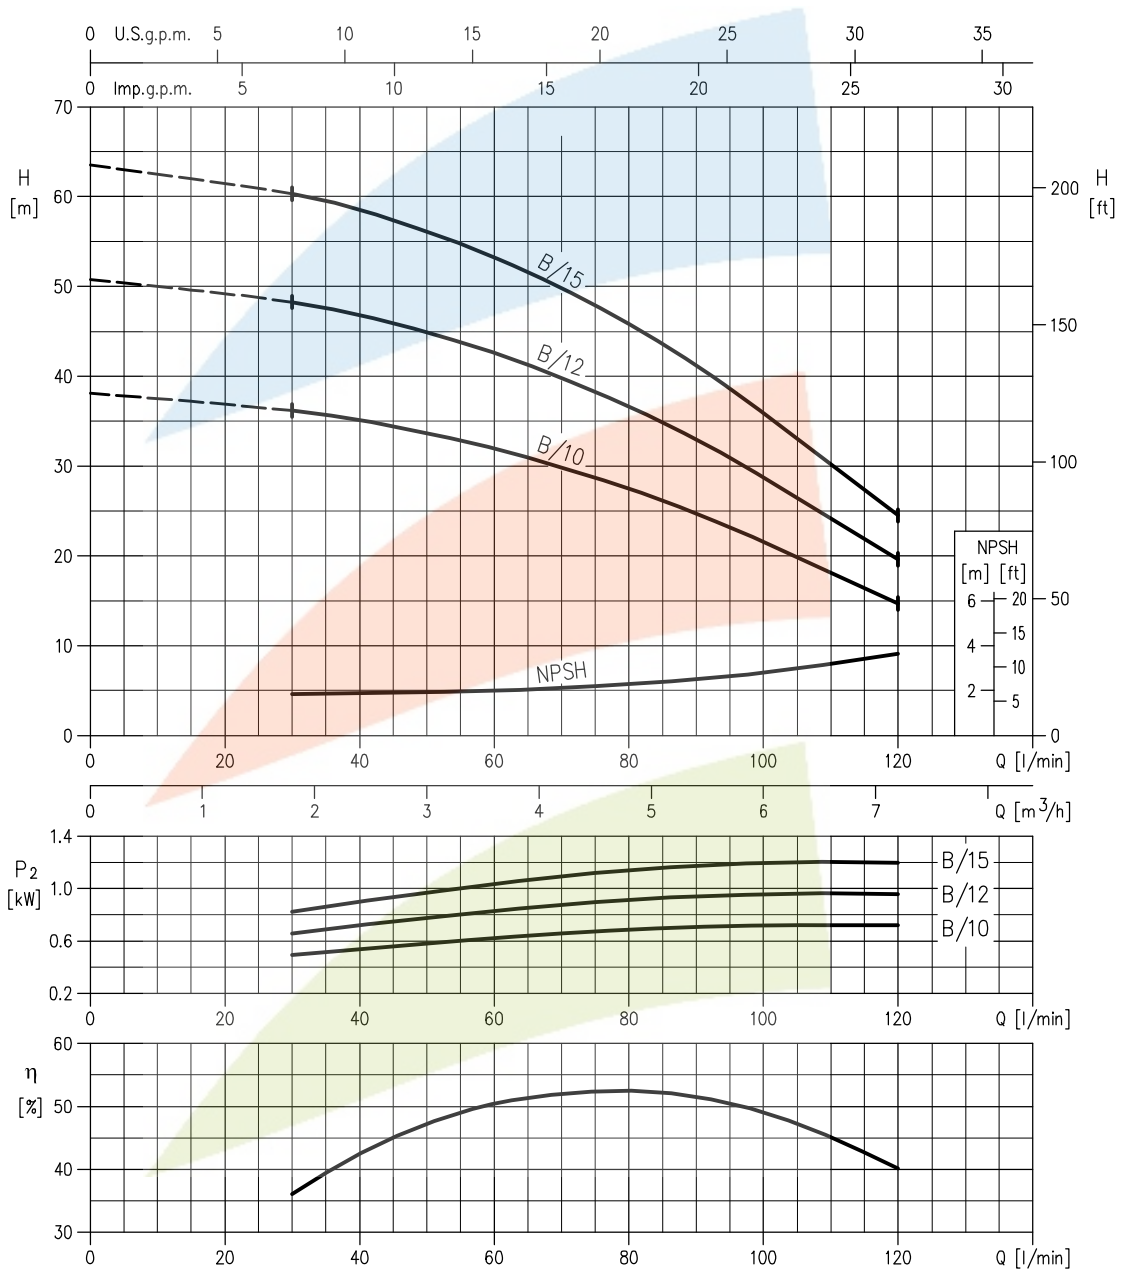

Rotation speed  $\approx 2800 \text{ min}^{-1}$   
 Test standard: ISO 9906 – Annex A

**CVM B/20 (1.5 kW) MEI > 0.70 - Impeller diameter = 102 mm**  
**CVM B/23 (1.7 kW) MEI > 0.70 - Impeller diameter = 102 mm**  
**CVM B/25 (1.85 kW) MEI > 0.70 - Impeller diameter = 102 mm**

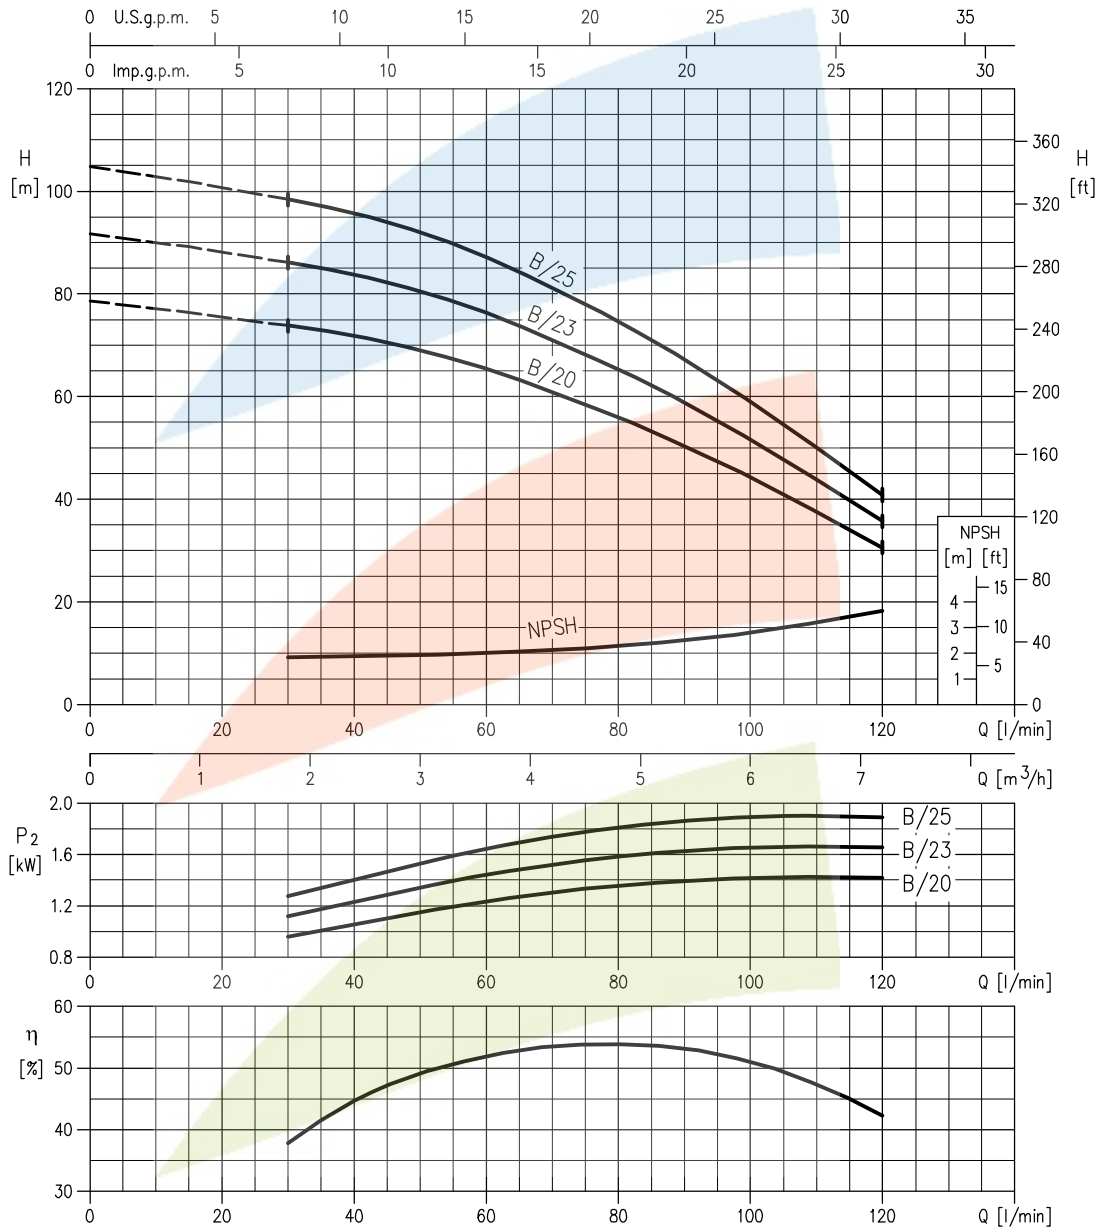

Rotation speed  $\approx 2800 \text{ min}^{-1}$   
 Test standard: ISO 9906 – Annex A